

# Thermocouple

## For additional thermowell, flameproof enclosure (Ex d)

### Model TC10-L

WIKA data sheet TE 65.12



for further approvals  
see page 2

#### Applications

- Chemical industry
- Petrochemical industry
- Offshore

#### Special features

- Sensor ranges from -40 ... +1,200 °C [-40 ... +2,192 °F]
- Measuring insert replaceable
- For many thermowell designs



Fig. left: Model TC10-L with connection head 7/8000

Fig. right: Model TC10-L with connection head 1/4000

#### Description

Thermocouples in this series can be combined with a large number of thermowell designs. Use without a thermowell is not permitted.

A wide variety of possible combinations of sensor, connection head, insertion length, neck length, connection to thermowell etc. are available for the thermometers; suitable for almost any thermowell dimension.

## Explosion protection (option)












The permissible power  $P_{max}$  as well as the permissible ambient temperature for the respective category can be seen on the EC-type examination certificate, the Ex certificate or in the operating instructions.

### Attention:


Only with the correspondingly suitable protective components is operation in dust Ex hazardous areas permissible.

The built-in transmitter has its own certificate. The permissible ambient temperature ranges of the built-in transmitters can be taken from the corresponding transmitter approval.

## Approvals (explosion protection, further approvals)

| Logo  | Description  | Country                     |
|---|--|-----------------------------|
|    | <b>EU declaration of conformity</b><br><ul style="list-style-type: none"> <li>■ EMC directive <sup>1)</sup><br/>EN 61326 emission (group 1, class B) and immunity (industrial application)</li> <li>■ RoHS directive</li> <li>■ ATEX directive (option)<br/>Hazardous areas               <ul style="list-style-type: none"> <li>- Ex d Zone 1 gas [II 2G Ex db IIB + H2 T6 ... T4 Gb]</li> <li>Zone 1 gas [II 2G Ex db IIC T6 ... T4 Gb] <sup>2)</sup></li> <li>Zone 21 dust [II 2D Ex tb IIIC T85 °C Db IP66]</li> </ul> </li> </ul> | European Union              |
|    |  |                             |
|    | <b>IECEx (option) - in conjunction with ATEX</b><br>Hazardous areas <ul style="list-style-type: none"> <li>- Ex d Zone 1 gas [Ex db IIB + H2 T6 ... T4 Gb]</li> <li>Zone 1 gas [Ex db IIC T6 ... T4 Gb] <sup>2)</sup></li> <li>Zone 21 dust [Ex tb IIIC T85 °C Db IP66]</li> </ul>   | International               |
|    | <b>EAC (option)</b><br>Hazardous areas <ul style="list-style-type: none"> <li>- Ex d Zone 1 mounting to zone 0 gas [Ga/Gb Ex d IIC T6...T1 X]</li> <li>Zone 1 gas [1 Ex d IIC T6...T1 Gb X]</li> <li>Zone 21 dust [Ex tb IIIC T80...T440 °C Db X]</li> </ul>   | Eurasian Economic Community |
|  | <b>INMETRO (option)</b><br>Hazardous areas <ul style="list-style-type: none"> <li>- Ex d Zone 1 gas [Ex db IIB + H2 T6 ... T4 Gb IP66]</li> <li>Zone 1 gas [Ex db IIC T6 ... T4 Gb IP66]</li> </ul>  | Brazil                      |
|  | <b>DNOP - MakNII (option)</b><br>Hazardous areas <ul style="list-style-type: none"> <li>- Ex d Zone 1 gas [II 2G Ex db IIB+H2 T6...T4 Gb]</li> <li>Zone 1 gas [II 2G Ex db IIC T6...T4 Gb]</li> </ul>  | Ukraine                     |
|  | <b>GOST (option)</b><br>Metrology, measurement technology  | Russia                      |
|  | <b>KazInMetr (option)</b><br>Metrology, measurement technology   | Kazakhstan                  |
| -   | <b>MTSCHS (option)</b><br>Permission for commissioning   | Kazakhstan                  |
|  | <b>BelGIM (option)</b><br>Metrology, measurement technology  | Belarus                     |
|  | <b>UkrSEPRO</b><br>Metrology, measurement technology   | Ukraine                     |
|  | <b>Uzstandard</b><br>Metrology, measurement technology   | Uzbekistan                  |

## Manufacturer's information and certificates

| Logo  | Description  |
|---|--|
|  | <b>SIL 2</b><br>Functional safety (only in conjunction with model T32 temperature transmitter) |

1) Only for built-in transmitter

2) With suitable solid-machined thermowell

Approvals and certificates, see website

## Sensor

### Thermocouple per IEC 60584-1 or ASTM E230

Types K, J, E, N, T (single or dual thermocouple)

#### Measuring point

- Ungrounded (standard)
- Grounded

#### Sensor types

| Type | Validity limits of class accuracy |                   |                |         |
|------|-----------------------------------|-------------------|----------------|---------|
|      | IEC 60584-1                       |                   | ASTM E230      |         |
|      | Class 2                           | Class 1           | Standard       | Special |
| K    | -40 ... +1,200 °C                 | -40 ... +1,000 °C | 0 ... 1,260 °C |         |
| J    | -40 ... +750 °C                   | -40 ... +750 °C   | 0 ... 760 °C   |         |
| E    | -40 ... +900 °C                   | -40 ... +800 °C   | 0 ... 870 °C   |         |
| N    | -40 ... +1,200 °C                 | -40 ... +1,000 °C | 0 ... 1,260 °C |         |
| T    | -40 ... +350 °C                   |                   | 0 ... 370 °C   |         |

The table shows the temperature ranges listed in the respective standards, in which the tolerance values (class accuracies) are valid.

The actual operating temperature of the thermometer is limited both by the maximum permissible working temperature and the diameter of the thermocouple and the sheathed cable, as well as by the maximum permissible working temperature of the thermowell material.


Listed models are available both as single or dual thermocouples. The thermocouple will be delivered with an ungrounded measuring point.

For detailed specifications for thermocouples, see IEC 60584-1 or ASTM E230 and Technical information IN 00.23 at [www.wika.com](http://www.wika.com).

#### Tolerance value

For the tolerance value of thermocouples, a cold junction temperature of 0 °C has been taken as the basis.

#### Electrical connection

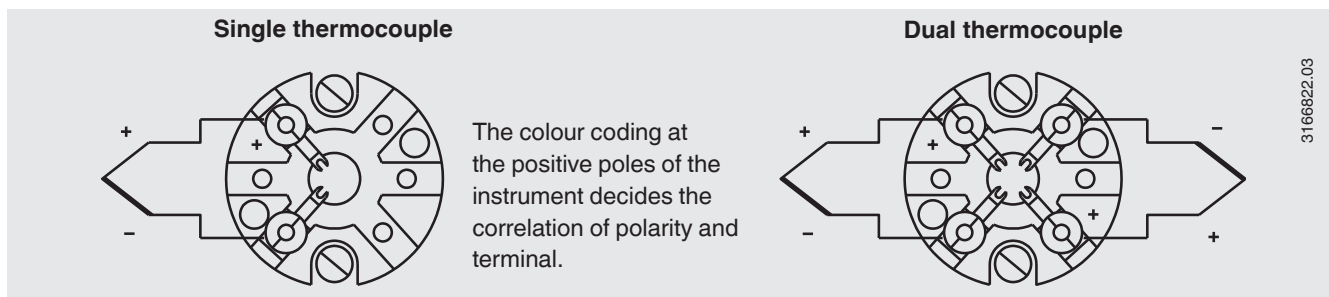


For the electrical connections of built-in temperature transmitters see the corresponding data sheets or operating instructions.


## Connection head



1/4000 F  
1/4000 S



7/8000 W  
7/8000 S



7/8000 W / DIH50  
7/8000 S / DIH50

| Model                          | Material        | Cable entry thread size | Ingress protection (max.) <sup>1)</sup> | Cover / Cap  | Surface                       | Connection to neck tube |
|--------------------------------|-----------------|-------------------------|---|--------------|-------------------------------|-------------------------|
| 1/4000 F                       | Aluminium       | ½ NPT, ¾ NPT, M20 x 1.5 | IP66 <sup>4)</sup>                      | Screw-on lid | Blue, lacquered <sup>2)</sup> | ½ NPT                   |
| 1/4000 S                       | Stainless steel | ½ NPT, ¾ NPT, M20 x 1.5 | IP66 <sup>4)</sup>                      | Screw-on lid | Blank                         | ½ NPT                   |
| 7/8000 W                       | Aluminium       | ½ NPT, ¾ NPT, M20 x 1.5 | IP66 <sup>4)</sup>                      | Screw-on lid | Blue, lacquered <sup>2)</sup> | ½ NPT                   |
| 7/8000 S                       | Stainless steel | ½ NPT, ¾ NPT, M20 x 1.5 | IP66 <sup>4)</sup>                      | Screw-on lid | Blank                         | ½ NPT                   |
| 7/8000 W / DIH50 <sup>3)</sup> | Aluminium       | ½ NPT, ¾ NPT, M20 x 1.5 | IP66 <sup>4)</sup>                      | Screw-on lid | Blue, lacquered <sup>2)</sup> | ½ NPT                   |
| 7/8000 S / DIH50 <sup>3)</sup> | Stainless steel | ½ NPT, ¾ NPT, M20 x 1.5 | IP66 <sup>4)</sup>                      | Screw-on lid | Blank                         | ½ NPT                   |

1) The ingress protection refers to the connection head, for information on the cable glands, see page 5

2) RAL 5022

3) DIH50 LC display

4) Suitable seal/cable gland required

## Connection head with digital display



Connection head 7/8000 W with LC display model DIH50  
see data sheet AC 80.10

To operate the digital display, a transmitter with a 4 ... 20 mA output is always required.

## Flame path fitting

A flame path fitting is built into the connection head which, in conjunction with the measuring insert, generates a flame-proof gap.

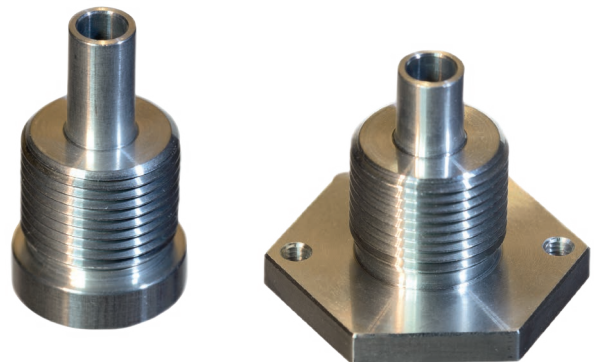


Fig. left: Flame path fitting for model 1/4000 connection head

Fig. right: Flame path fitting for 7/8000 and 7/8000 connection heads with DIH50

## Cable entry



**Ex d cable gland stainless steel**



**Plain threaded**



**Sealing plugs for transport**

The figures show examples of threaded connections and connection heads.

| Cable entry                      | Cable entry thread size |
|----------------------------------|-------------------------|
| Ex d cable gland stainless steel | M20 x 1.5 or ½ NPT      |
| Plain threaded                   | M20 x 1.5 or ½ NPT      |
| Sealing plugs for shipping       | M20 x 1.5 or ½ NPT      |

| Cable entry                      | Colour      | Ingress protection (max.) | Min./max. ambient temperature      |
|----------------------------------|-------------|---------------------------|------------------------------------|
| Ex d cable gland stainless steel | Blank       | IP66                      | -60 <sup>1)</sup> / -40 ... +80 °C |
| Plain threaded                   | -           | IP00                      | -                                  |
| Sealing plugs for transport      | Transparent | -                         | -40 ... +80 °C                     |

1) Special version on request (only available with selected approvals), other temperatures on request

## Ingress protection



to IP66 per IEC/EN 60529 under the following conditions:

- Use of a suitable cable gland
- Use of a cable cross-section appropriate for the gland or select the appropriate cable gland for the available cable
- Adhere to the tightening torques for all threaded connections


## Transmitter

### Mounting onto the measuring insert

With mounting on the measuring insert, the transmitter replaces the terminal block and is fixed directly to the terminal plate of the measuring insert.

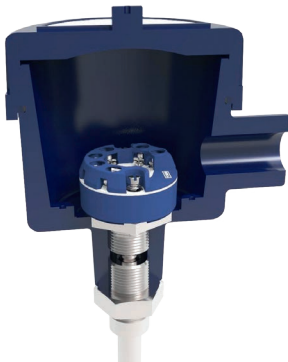

**Measuring insert with mounted transmitter (here: model T32)**

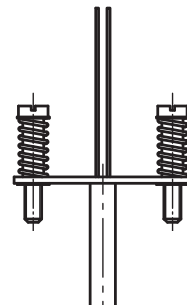

**Measuring insert prepared for transmitter mounting**

## Transmitter models



| Output signal 4 ... 20 mA, HART® protocol, FOUNDATION™ Fieldbus and PROFIBUS® PA |               |               |               |
|--|---------------|---------------|---------------|
| Transmitter (selectable versions)  | Model T16     | Model T32     | Model T53     |
| Data sheet   | TE 16.01      | TE 32.04      | TE 53.01      |
| <b>Output</b>  |               |               |               |
| ■ 4 ... 20 mA  | x             | x             |               |
| ■ HART® protocol   |               | x             |               |
| ■ FOUNDATION™ Fieldbus and PROFIBUS® PA  |               |               | x             |
| <b>Input</b>   |               |               |               |
| ■ Thermocouples IEC 60584-1  | K, J, E, N, T | K, J, E, N, T | K, J, E, N, T |
| <b>Explosion protection</b>  | Optional      | Optional      | Standard      |

## Possible mounting positions for transmitters

| Connection head                    | T16 | T32 | T53 |
|------------------------------------|-----|-----|-----|
| 1/4000 F, 1/4000 S                 | ○   | ○   | ○   |
| 7/8000 W, 7/8000 S                 | ○   | ○   | ○   |
| 7/8000 W / DIH50, 7/8000 S / DIH50 | ○   | ○   | -   |

○ Mounted instead of terminal block

– Mounting not possible

The mounting of a transmitter on the measuring insert is possible with all the connection heads listed here. The fitting of a transmitter in the (screw) cap of a North American design connection head is not possible.

Mounting of 2 transmitters on request.

For a correct determination of the overall measuring deviation, the sensor and transmitter measuring deviations must be added.

## Functional safety (option) with temperature transmitter model T32



In safety-critical applications, the entire measuring chain must be taken into consideration in terms of the safety parameters. The SIL classification allows the assessment of the risk reduction achieved by the safety installations.


Selected TC10-L thermocouples, in combination with a suitable temperature transmitter (e.g. model T32.1S, TÜV certified SIL version for protection systems developed in accordance with IEC 61508), are suitable as sensors for safety functions to SIL 2.

For detailed specifications, see Technical information IN 00.19 at [www.wika.com](http://www.wika.com).


# Components model TC10-L

3112147.04


## “Nipple-union-nipple” neck tube

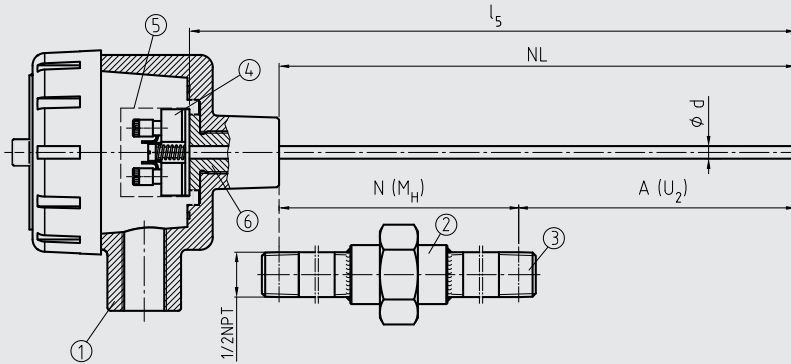

## Double threaded hex bushing (tube section)

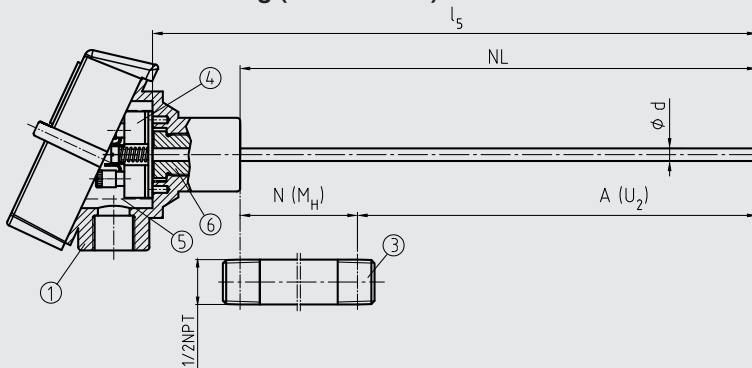


## Double threaded hex bushing (with hexagonal spanner flats)

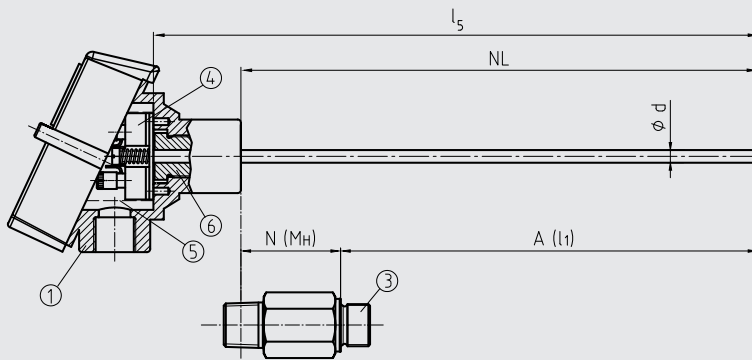

3112287.03

## Neck tube with counter nut to head

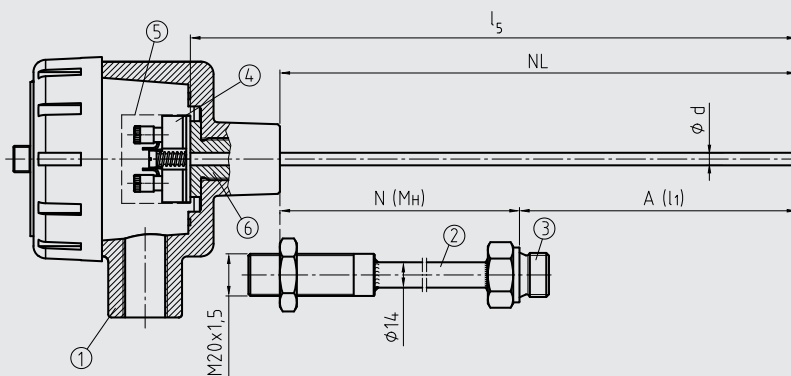


### Legend:

- ① Connection head
- ② Neck tube
- ③ Connection to thermowell
- ④ Measuring insert
- ⑤ Transmitter (option)
- ⑥ Flame path fitting

- A (I1) Insertion length (with parallel threads)
- A (U2) Insertion length (with tapered threads)
- l5 Measuring insert length
- Ø d Measuring insert diameter
- NL Nominal length
- N (MH) Neck length

# Neck tube

## Neck tube designs

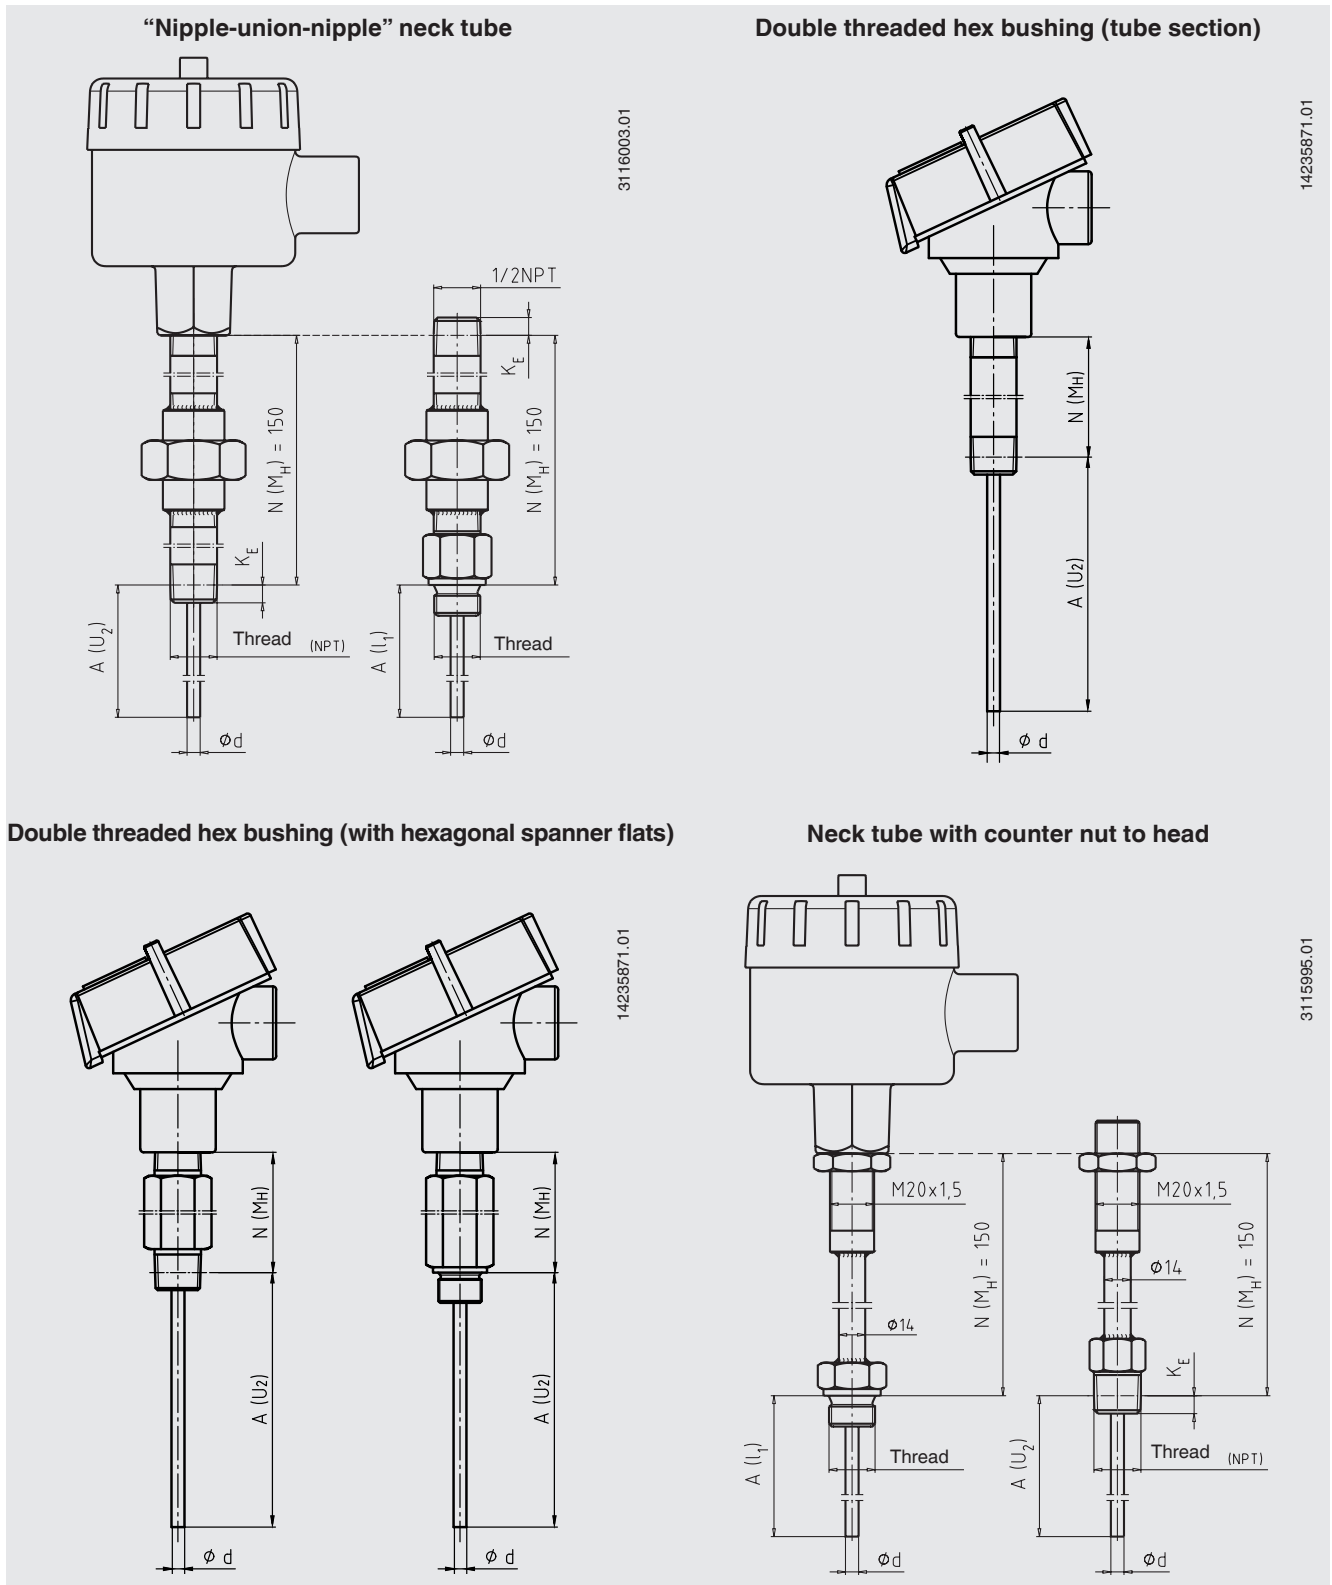

**Legend:**

A (I<sub>1</sub>) Insertion length (with parallel threads)  
 A (U<sub>2</sub>) Insertion length (with tapered threads)  
 N (M<sub>H</sub>) Neck length

Ø d Measuring insert diameter  
 K<sub>E</sub> Screw-in length by hand  
 - with 1/2 NPT approx. 8.1 mm  
 - with 3/4 NPT approx. 8.6 mm



## Neck tube versions

| Neck tube design   | Diameter    | Connection to head           | Connection to thermowell | Material |
|--|-------------|------------------------------|--------------------------|----------|
| "Nipple-union-nipple" neck tube                            | ~ 22 mm     | ½ NPT                        | Mounting thread          | 316      |
|  | ~ 27 mm     | ¾ NPT                        |                          |          |
| Double threaded hex bushing (tube section)                 | ~ 22 mm     | ½ NPT                        | Mounting thread          | 316      |
|  | ~ 27 mm     | ¾ NPT                        |                          |          |
| Double threaded hex bushing (with hexagonal spanner flats) | -           | M24 x 1.5 / ½ NPT            | Mounting thread          | 1.4571   |
| Neck tube with counter nut to head                         | 14 x 2.5 mm | M20 x 1.5 (with counter nut) | Mounting thread          | 1.4571   |

## Thread sizes

| Neck tube design   | Diameter    | Thread to the thermowell |
|--|-------------|--------------------------|
| "Nipple-union-nipple" neck tube                            | ~ 22 mm     | ½ NPT                    |
|  | ~ 27 mm     | ¾ NPT                    |
| Double threaded hex bushing (tube section)                 | ~ 22 mm     | ½ NPT                    |
|  | ~ 27 mm     | ¾ NPT                    |
| Double threaded hex bushing (with hexagonal spanner flats) | -           | G ½ B                    |
|  |             | G ¾ B                    |
|  |             | G ¼ B                    |
|  |             | ½ NPT                    |
|  |             | ¾ NPT                    |
|  |             | M14 x 1.5                |
|  |             | M18 x 1.5                |
|  |             | M20 x 1.5                |
| Neck tube with counter nut to head                         | 14 x 2.5 mm | ½ NPT                    |
|  |             | ¾ NPT                    |
|  |             | G ½ B                    |
|  |             | G ¾ B                    |
|  |             | G ¼ B                    |
|  |             | M14 x 1.5                |
|  |             | M18 x 1.5                |
|  |             | M20 x 1.5                |

## Neck lengths

| Neck tube design   | Neck length             | Min. / Max. neck length                           |
|--|-------------------------|---|
| "Nipple-union-nipple" neck tube                            | 150 mm (approx. 6 inch) | 75 mm (approx. 3 inch) / 250 mm (approx. 10 inch) |
| Double threaded hex bushing (tube section)                 | 50 mm (approx. 2 inch)  | 50 mm (approx. 2 inch) / 250 mm (approx. 10 inch) |
| Double threaded hex bushing (with hexagonal spanner flats) | 25 mm                   |   |
| Neck tube with counter nut to head                         | 150 mm (approx. 6 inch) | 75 mm (approx. 3 inch) / 250 mm (approx. 10 inch) |


The neck tube is screwed into the connection head. The neck length depends on the intended use. Usually an isolation is bridged by the neck tube. Also, in many cases, the neck tube serves as a cooling extension between the connection head and the medium, in order to protect a possible built-in transmitter from high medium temperatures.

Other versions on request

## Measuring insert

Within the TC10-L, the measuring insert of model TC10-K is fitted.

The replaceable measuring insert is made of a vibration-resistant, sheathed measuring cable (MI cable).




Pay special attention to the assembly/disassembly of the measuring insert. The surface of the sheathed cable of the measuring insert must not be damaged! (No creases, grooves, scratches etc.). Any damaged measuring insert must be replaced. It is advisable to renew the corresponding flame path fitting in this case.

### Attention:

Only correct measuring insert length and correct measuring insert diameter ensure sufficient heat transfer from thermowell to the measuring insert. The bore diameter of the thermowell should be a max. 1 mm larger than the measuring insert diameter. Gaps of more than 0.5 mm between thermowell and the measuring insert will have a negative effect on the heat transfer, and they will result in unfavourable response behaviour of the thermometer.

When fitting the measuring insert into a thermowell, it is very important to determine the correct insertion length (= thermowell length for bottom thicknesses of  $\leq 5.5$  mm). In order to ensure that the measuring insert is firmly pressed down onto the bottom of the thermowell, the measuring insert must be spring-loaded (spring travel: max. 10 mm).


## Dimensions in mm

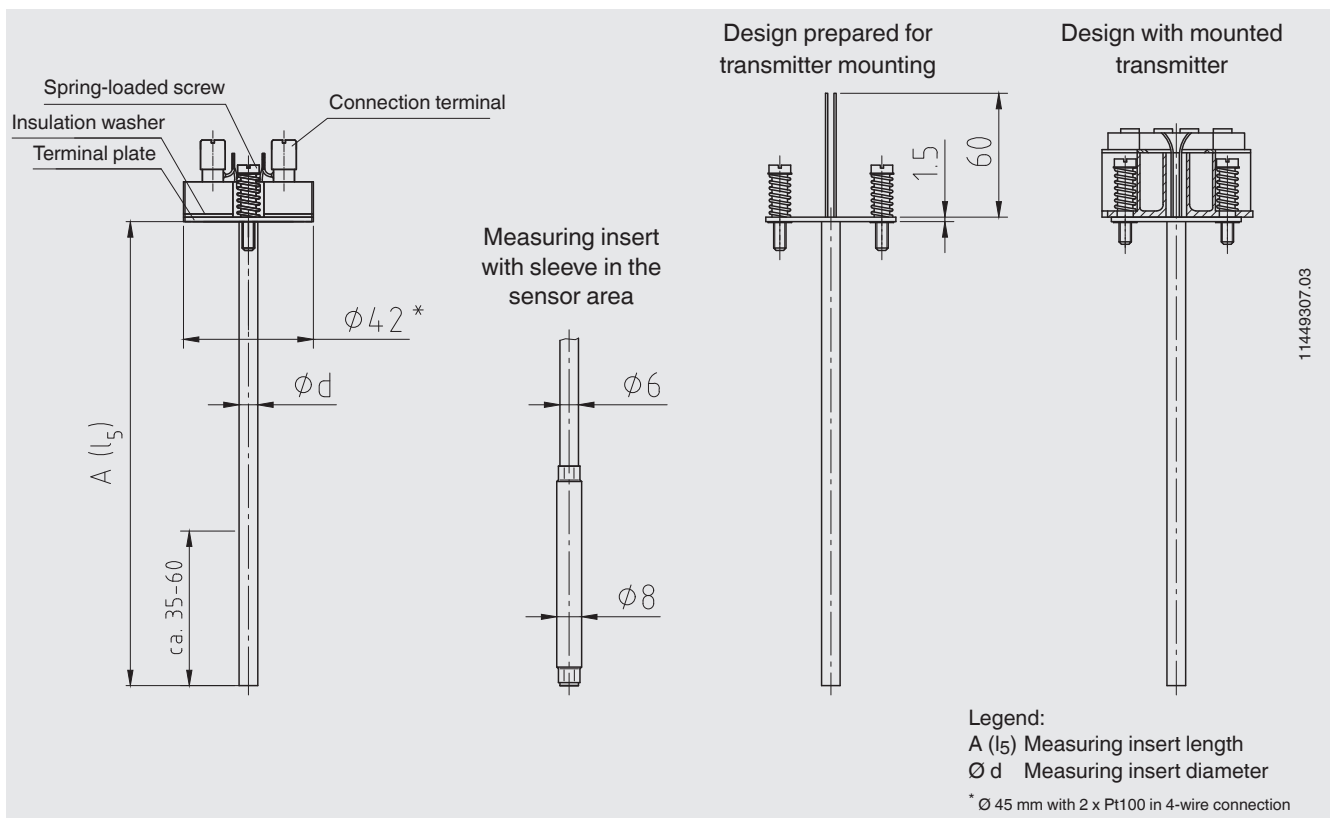

| Measuring insert diameter Ø d in mm | Sheath material            |
|-------------------------------------|----------------------------|
| 3 <sup>1)</sup>                     | 1.4571, 316L <sup>1)</sup> |
| 6                                   | 1.4571, 316L <sup>1)</sup> |
| 8 (6 mm with sleeve)                | 1.4571                     |

1) Not possible with 2 x 4-wire versions

## Thermowell selection

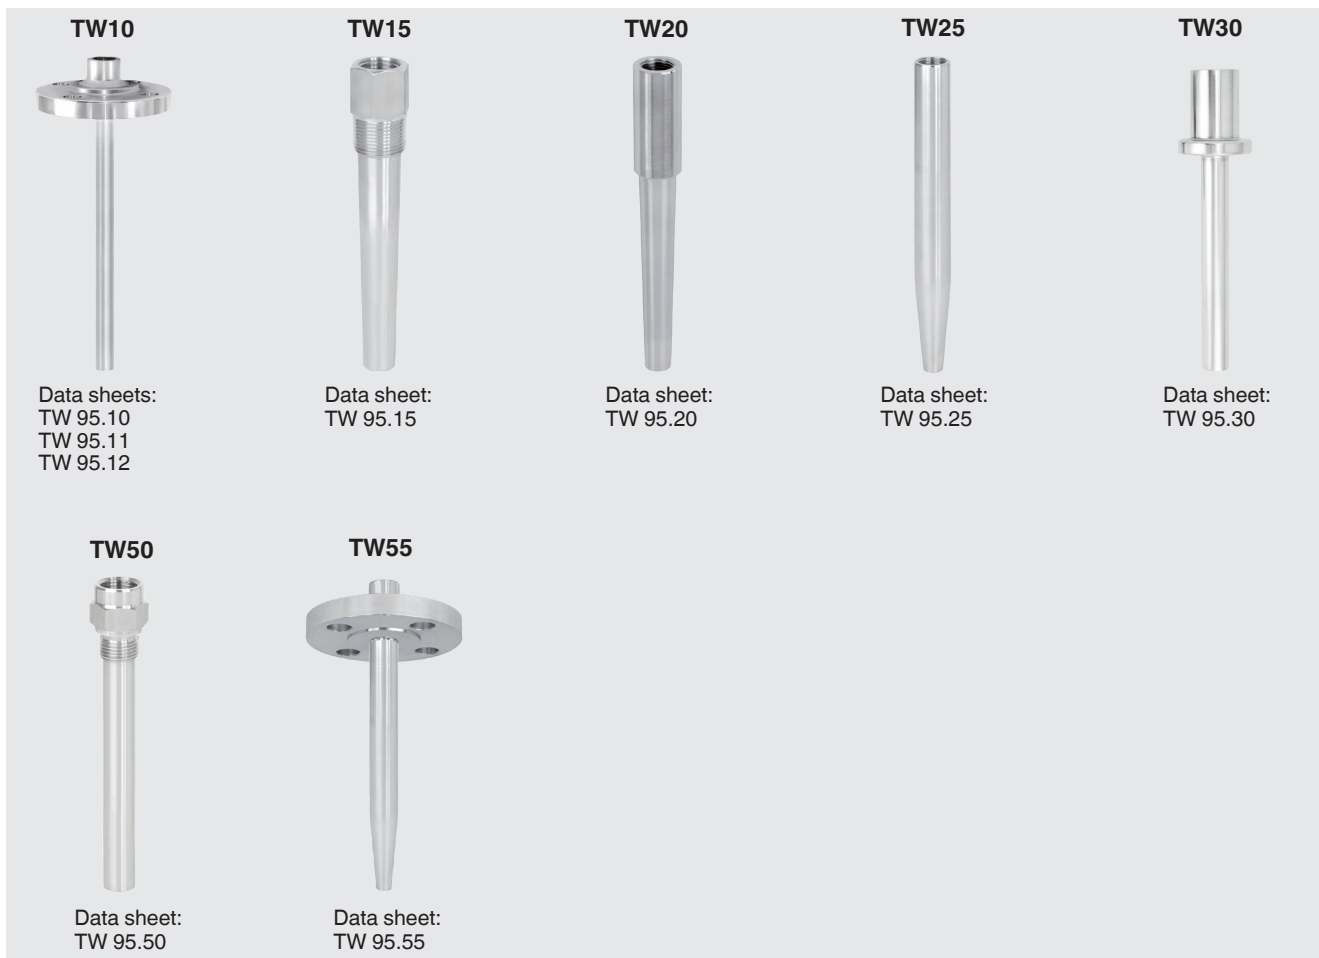

Special thermowells on request

## Operating conditions

### Mechanical requirements

| Version         |  |
|-----------------|--|
| <b>Standard</b> | 6 g peak-to-peak, wire-wound measuring resistor or thin film                               |
| <b>Option</b>   | Vibration-resistant probe tip, max. 20 g peak-to-peak, thin-film measuring resistor        |
|                 | Highly vibration-resistant probe tip, max. 50 g peak-to-peak, thin-film measuring resistor |

The information on vibration resistance refers to the tip of the measuring insert.

For detailed specifications on the vibration resistance of Pt100 sensors, see Technical information IN 00.17 at [www.wika.com](http://www.wika.com).

### Ambient and storage temperature

-60 <sup>1)</sup> / -20 ... +80 °C

1) Special version on request (only available with specific approvals)

Other ambient and storage temperatures on request

## Certificates

| Certification type                       | Measurement accuracy | Material certificate <sup>2)</sup> |
|--|----------------------|------------------------------------|
| <b>2.2 test report</b>                   | x                    | x                                  |
| <b>3.1 inspection certificate</b>        | x                    | x                                  |
| <b>DKD/DAkkS calibration certificate</b> | x                    | -                                  |

The different certifications can be combined with each other.

2) Thermowells have their own material certificates

### Ordering information

Model / Explosion protection / Process connection / Version and material of threaded connection / Thread size / Measuring element / Connection method / Temperature range / Probe diameter / Insertion length A / Neck length N(M<sub>H</sub>) / Certificates / Options

© 09/2003 WIKA Alexander Wiegand SE & Co. KG, all rights reserved.  
The specifications given in this document represent the state of engineering at the time of publishing.  
We reserve the right to make modifications to the specifications and materials.

